

CODIFICATION FOR FL 700

CODE	INPUT						
01	:4- 20mA DC						
02	:1-5V DC						
		CODE	RELAY OUTPUT				
		01	:NONE				
		02	:HIGH				
		03	:LOW				
		04	: HIGH & LOW				
		CODE	RETRANSMISSION OUTPUT				
		01	:NONE				
		02	:4-20MA DC,ISOLATED				
		CODE	TRANSMITTER POWER SUPPLY				
		01	: NONE				
		02	: 24 V DC,30MA				
		03	: OTHER (PL.SPECIFY)				
		CODE	POWER SUPPLY				
		01	:110 V AC				
		02	:230 V AC				
		CODE	COMMUNICATOIN PORT				
		01	: NONE				
		02	: RS 232 (MODBUS RTU)				
		03	: RS 485 (MODBUS RTU)				

FL- 700

01

01

01


01

01

02

SAMPLE MODEL NUMBER

MOUNTING DETAILS

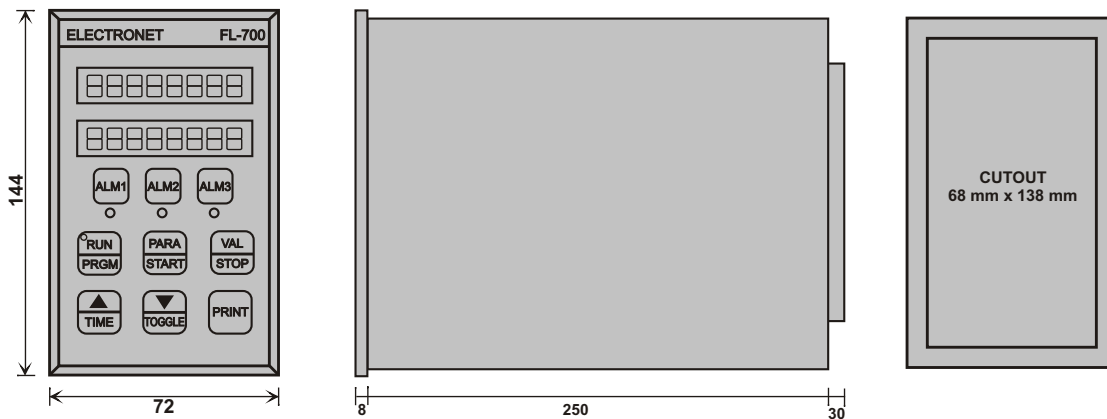

Due to our continuous product revisions, Design, Specifications and Model Numbers are subject to change without notice.

MANUFACTURED & MARKETING BY

ELECTRONET EQUIPMENTS PVT. LTD
 PROCESS CONTROL INSTRUMENTS & AUTOMATION

Plot No 85 & 86, Tiny Industrial Estate, Kondhwa Bk.

Pune - 411 048, Maharashtra, India

Telefax: +91 20 2693 4122 / 1476

E-mail: elecnet@vsnl.com / eeplsales@dataone.in

Web: www.electronetequipments.com

REP BY: